


# BC-160 Battery Cabinet - Installation Instruction

The **BC-160 Battery Cabinet** it comes complete with a lockable bottom hinged door that opens downwards to allow access to the battery compartment.

- Place the BC-160 Cabinet in a clean, dry, vibration-free area, a minimum of 6" below the Fire Alarm Control Panel it is being used with.
- Align the BC-160 Cabinet and Control Panel knock-outs so as to simplify conduit installation.
- Mount the BC-160 Cabinet, using the 6 pre-drilled mounting holes, to the wall.
- Connect the BC-160 Cabinet to the Control Panel cabinet with conduit between the adjacent knock-outs.

**Note:** Door not shown / All dimensions in Inches

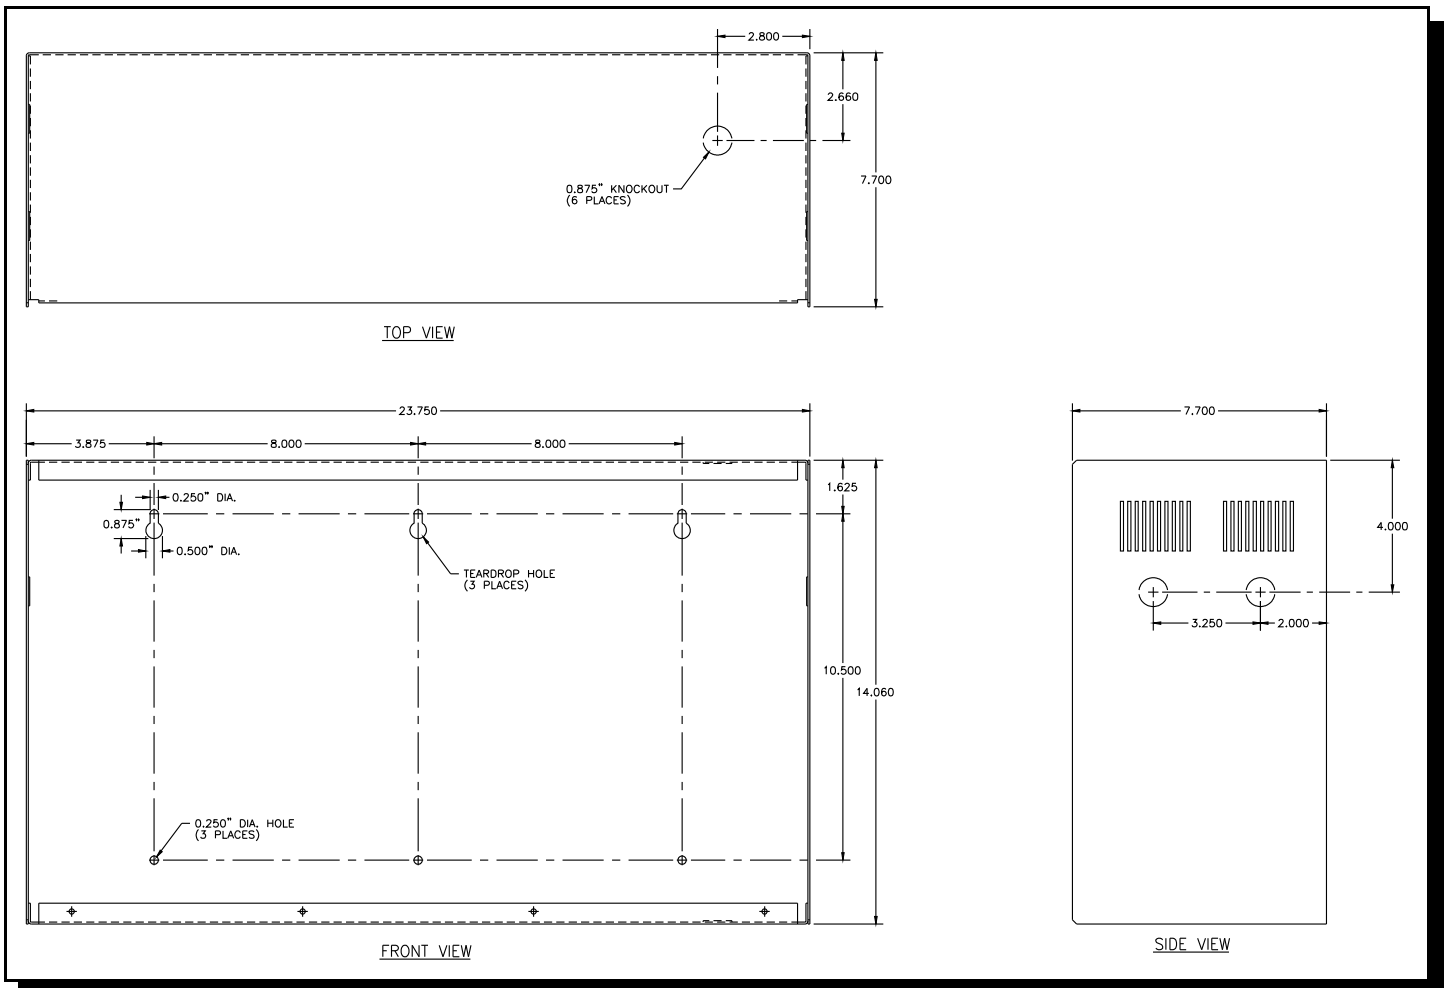

# WARRANTY

**MIRCOM Technologies Ltd.**, manufactured equipment is guaranteed to be free of defects in material and workmanship for a period of one (2) year from the date of original shipment. MIRCOM will repair or replace, at its option, any equipment which it determines to contain defective material or workmanship. Said equipment must be shipped to MIRCOM prepaid. Return freight will be prepaid by MIRCOM. We shall not be responsible to repair or replace equipment which has been repaired by others, abused, improperly installed, altered or otherwise misused or damaged in any way. Unless previously contracted by MIRCOM, MIRCOM will assume no responsibility for determining the defective or operative status at the point of installation, and will accept no liability beyond the repair or replacement of the product at our factory authorized service depot.

***Head Office:***

**MIRCOM Technologies Ltd.**

25 Interchange Way  
Vaughan, Ontario  
Canada L4K 5W3  
Tel.: (905) 660-4655  
Fax: (905) 660-4113

email: [mail@mircom.com](mailto:mail@mircom.com)

***U.S.A. Distribution Centre:***

**MIRCOM Technologies Inc.**

60 Industrial Parkway PMB 278  
Cheektowaga, New York  
U.S.A. 14277  
Tel.: (888) 660-4655  
Fax: (888) 660-4113

Web Site: <http://www.mircom.com>